


SUPERIOR FIRE PROTECTION SERVICES  
Rafael Castillo  
7 NOV 2016

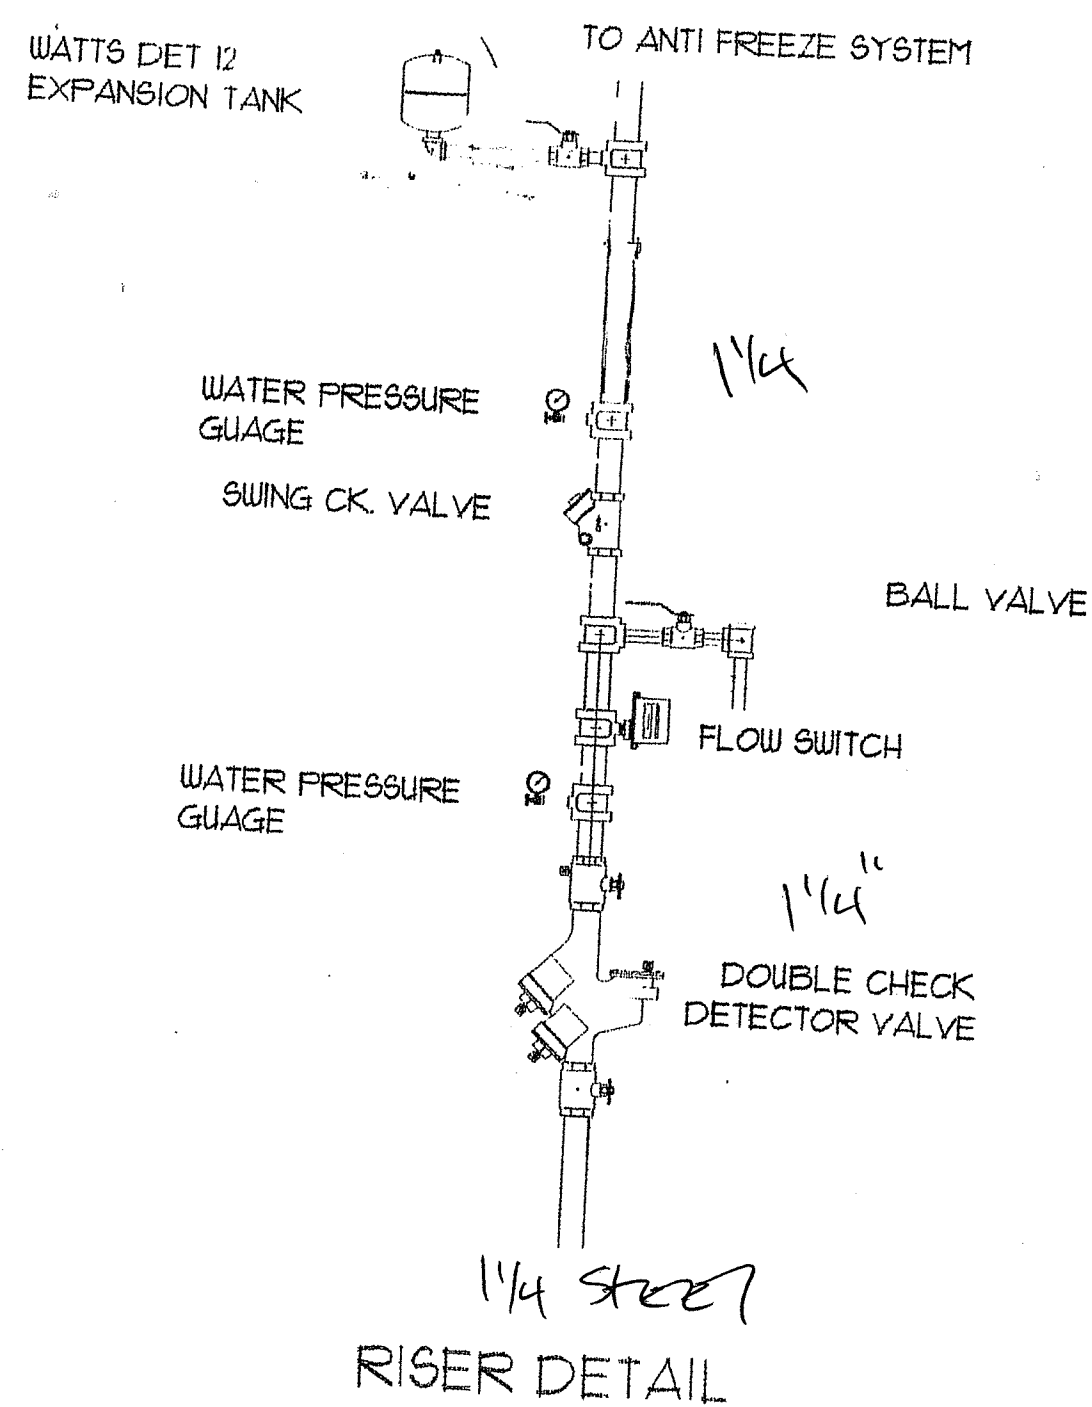

ASPEN FIRE PROTECTION  
875 S. CANYON RD  
SANTAQUIN, UTAH 84655

PROJECT: LEW Chapple SPEC DATE: 10-19-16  
ADDRESS: Lot 988 Timberlakes UT SCALE: 1/4" = 1'-0"

SPRINKLER SYMBOL TABLE							
SYMBOL	SIZE	STYLE	MAKE	MODEL	TEMP	K-FACTOR	TOTAL
⊗	1/2	CONC	SENDO	8464	162	4.9	25
●	1/2	PEND	TYCO	7334	155	4.9	1
TOTAL SPRINKLERS							26
INTERIOR						GARAGE	

- 16' x 16' spacing
  - 8' off walls
  - All piping 1" CPVZ
  - 1 1/4" CPVZ Rise up
  - SENDO 8464 Heads
  - 1 1/4" steel riser
  - NO ANTI FREEZE
- 20' X 20' SPACING PER HYD  
CALCS IS ACCEPTABLE



Spec

①

