

1 1 1/2" OR 2" WATER SERVICE


SCALE: NONE

2 GREASE TRAP & SAMPLING MANHOLE

SCALE: NONE

GENERAL NOTES

- All taps are to be hot-tapped only. No hot taps will be allowed on Friday. A minimum of 24 hours notice is required prior to the tap.
- A down stream valve is required inside the fireline box.
- The tapping valve can be used as the upstream valve.
- The tapping valve must have a slip type valve box and must be set to finish grade.
- Floor must have a minimum of 6" of gravel spread evenly throughout.
- All knock-outs for pipe coming into and going out of the box must be cement grouted once pipe is in place.
- All bolts & nuts upstream of the box must be greased and wrapped. All bolts will be coated with an acceptable thread lubricant prior to installation.
- Standard size 24" ring and lid is required for vault entrance.
- Typical fireline vault is to be a minimum of 5'x6' o.d. in size with gravel bottom.
- A 14-gauge underground rated locating wire must be laid with the pipe if using C-900.

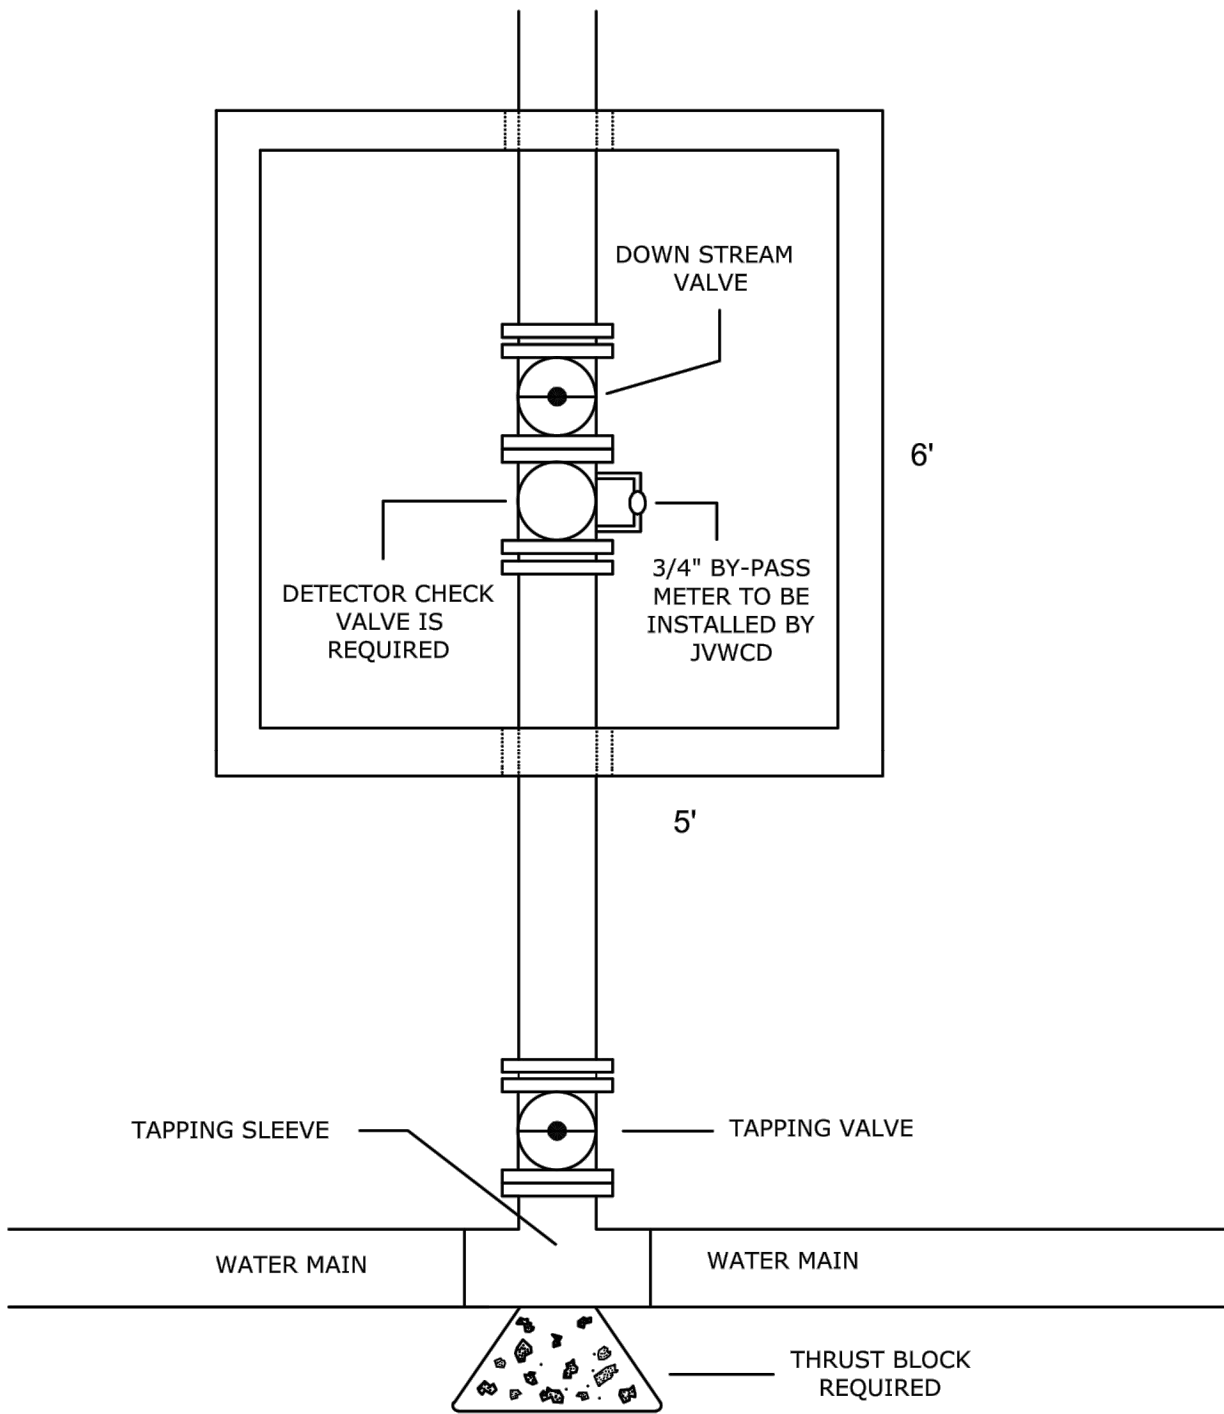

3 TYPICAL FIRELINE BOX DETAIL

SCALE: NONE



SALT LAKE CITY  
45 W. 10000 S., Suite 500  
Sandy, UT 84070  
Phone: 801.255.0529

LAYTON  
Phone: 801.547.1100

TOOELE  
Phone: 435.843.3590

CEDAR CITY  
Phone: 435.865.1453

RICHFIELD  
Phone: 435.896.2983

WWW.ENSIGNENG.COM

FOR:

CONTACT:

PHONE:

BRIGHTON RECOVERY CENTER

4895 S 900 E  
SALT LAKE COUNTY, UTAH



NO.	DATE	REVISION	BY
1	01/20/2017	WATER LINE CHANGES	MSB
2		ADDENDUM #6	
3			
4			
5			
6			
7			
8			

DETAILS

PROJECT NUMBER  
7227

PRINT DATE  
2/13/17

DRAWN BY  
M. BUDGE

CHECKED BY

PROJECT MANAGER  
D. JENKINS

C-200