




NOTES: 1. NOZZLES SHOWN ARE ADDED BELOW GRID OR IN THE BATHROOM HARD LID.
2. NOZZLES SHOWN ARE V2708 155F DEG. WHITE PENDANT SSP

JOB: SPRINT Station Park ste. N-140 Farmington, UT 84025		FIRE SUPPRESSION SERVICES, INC. 3802 So. 2300 E. Salt Lake City, UT 84109-3421 Ph: (801)277-6464 Fax: (801)278-2199 Email: fireslc@gmail.com Contractors License No. 92-252208-5501
AS BUILT? YES ☐ NO ☐		
TO BE INSTALLED BY: Randy Parker	DATE: 10-31-2018	
TEST WITNESSED BY:	Drawn By: Wm. R. Gubler	

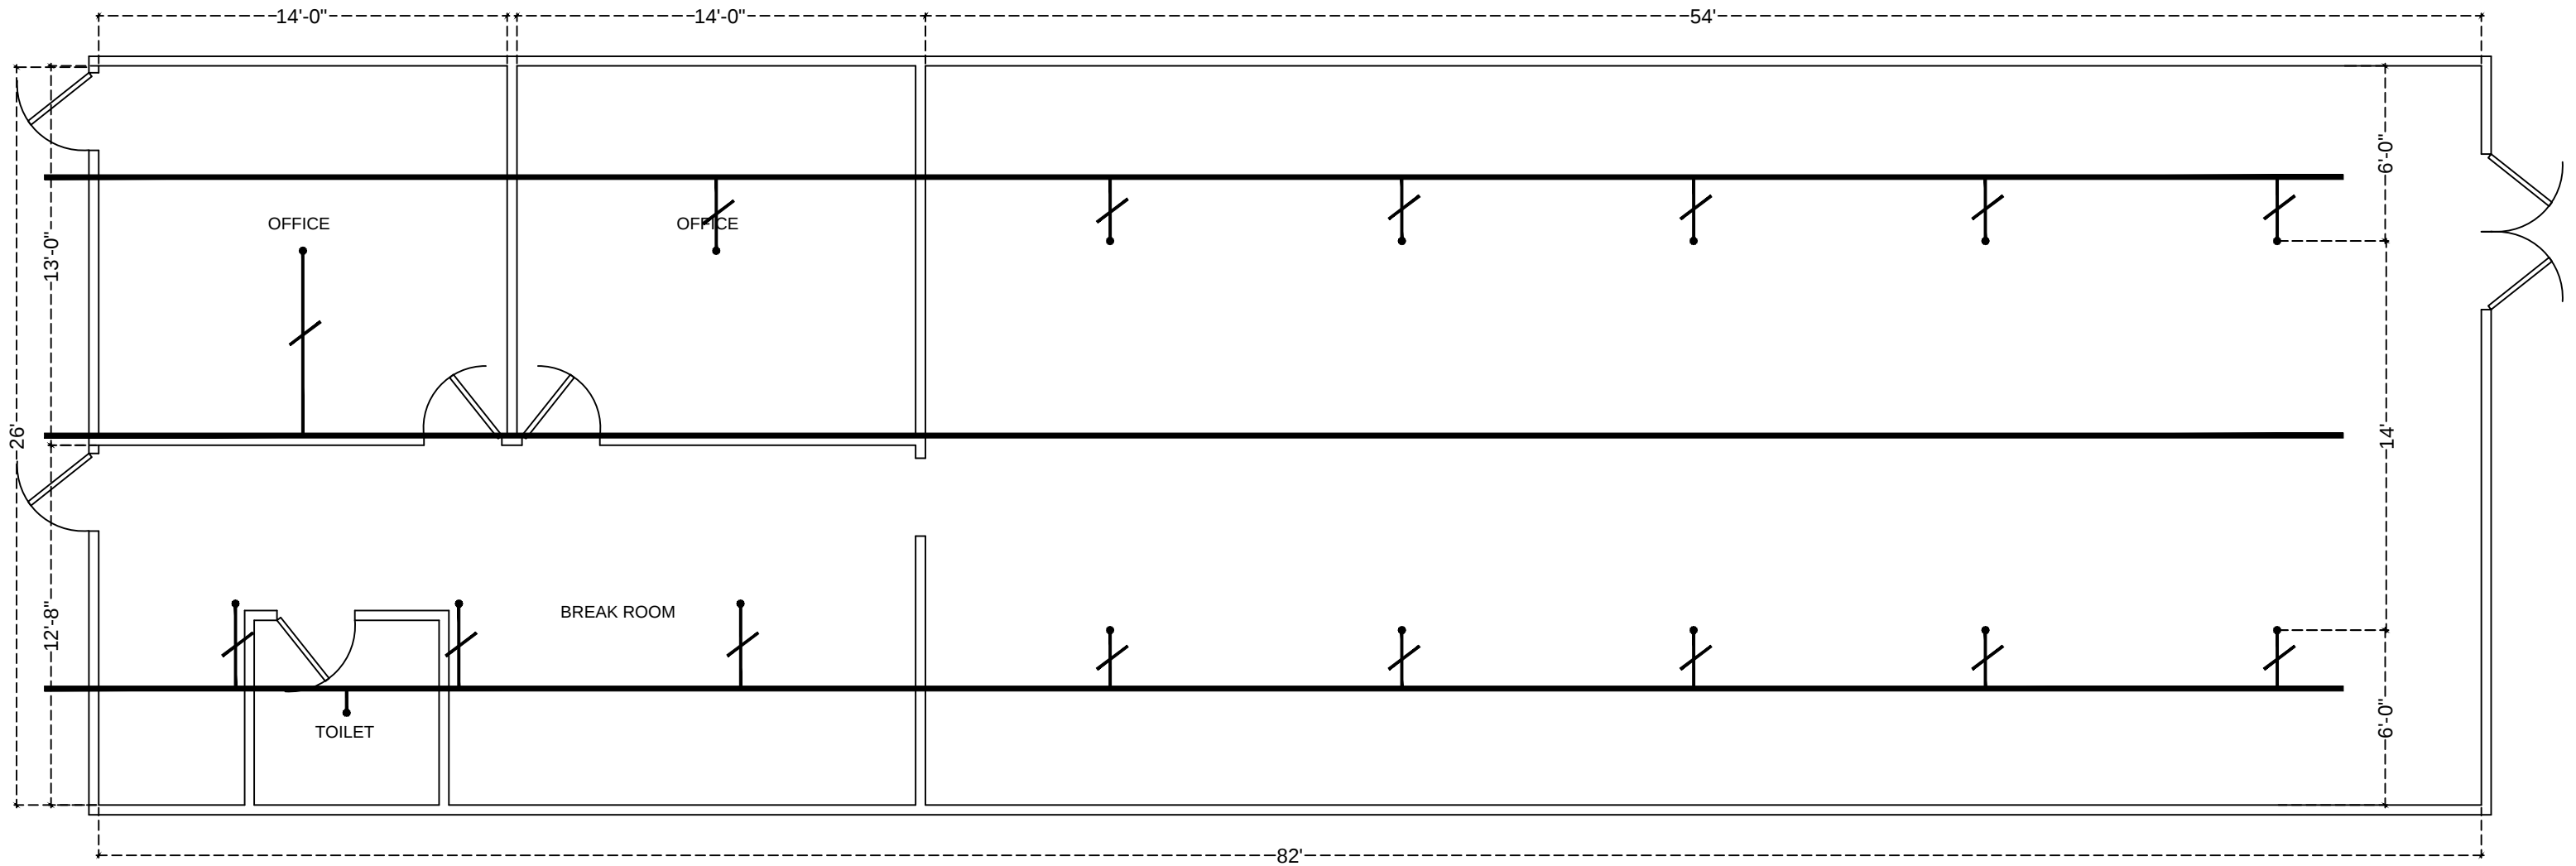