


D

C

B

A

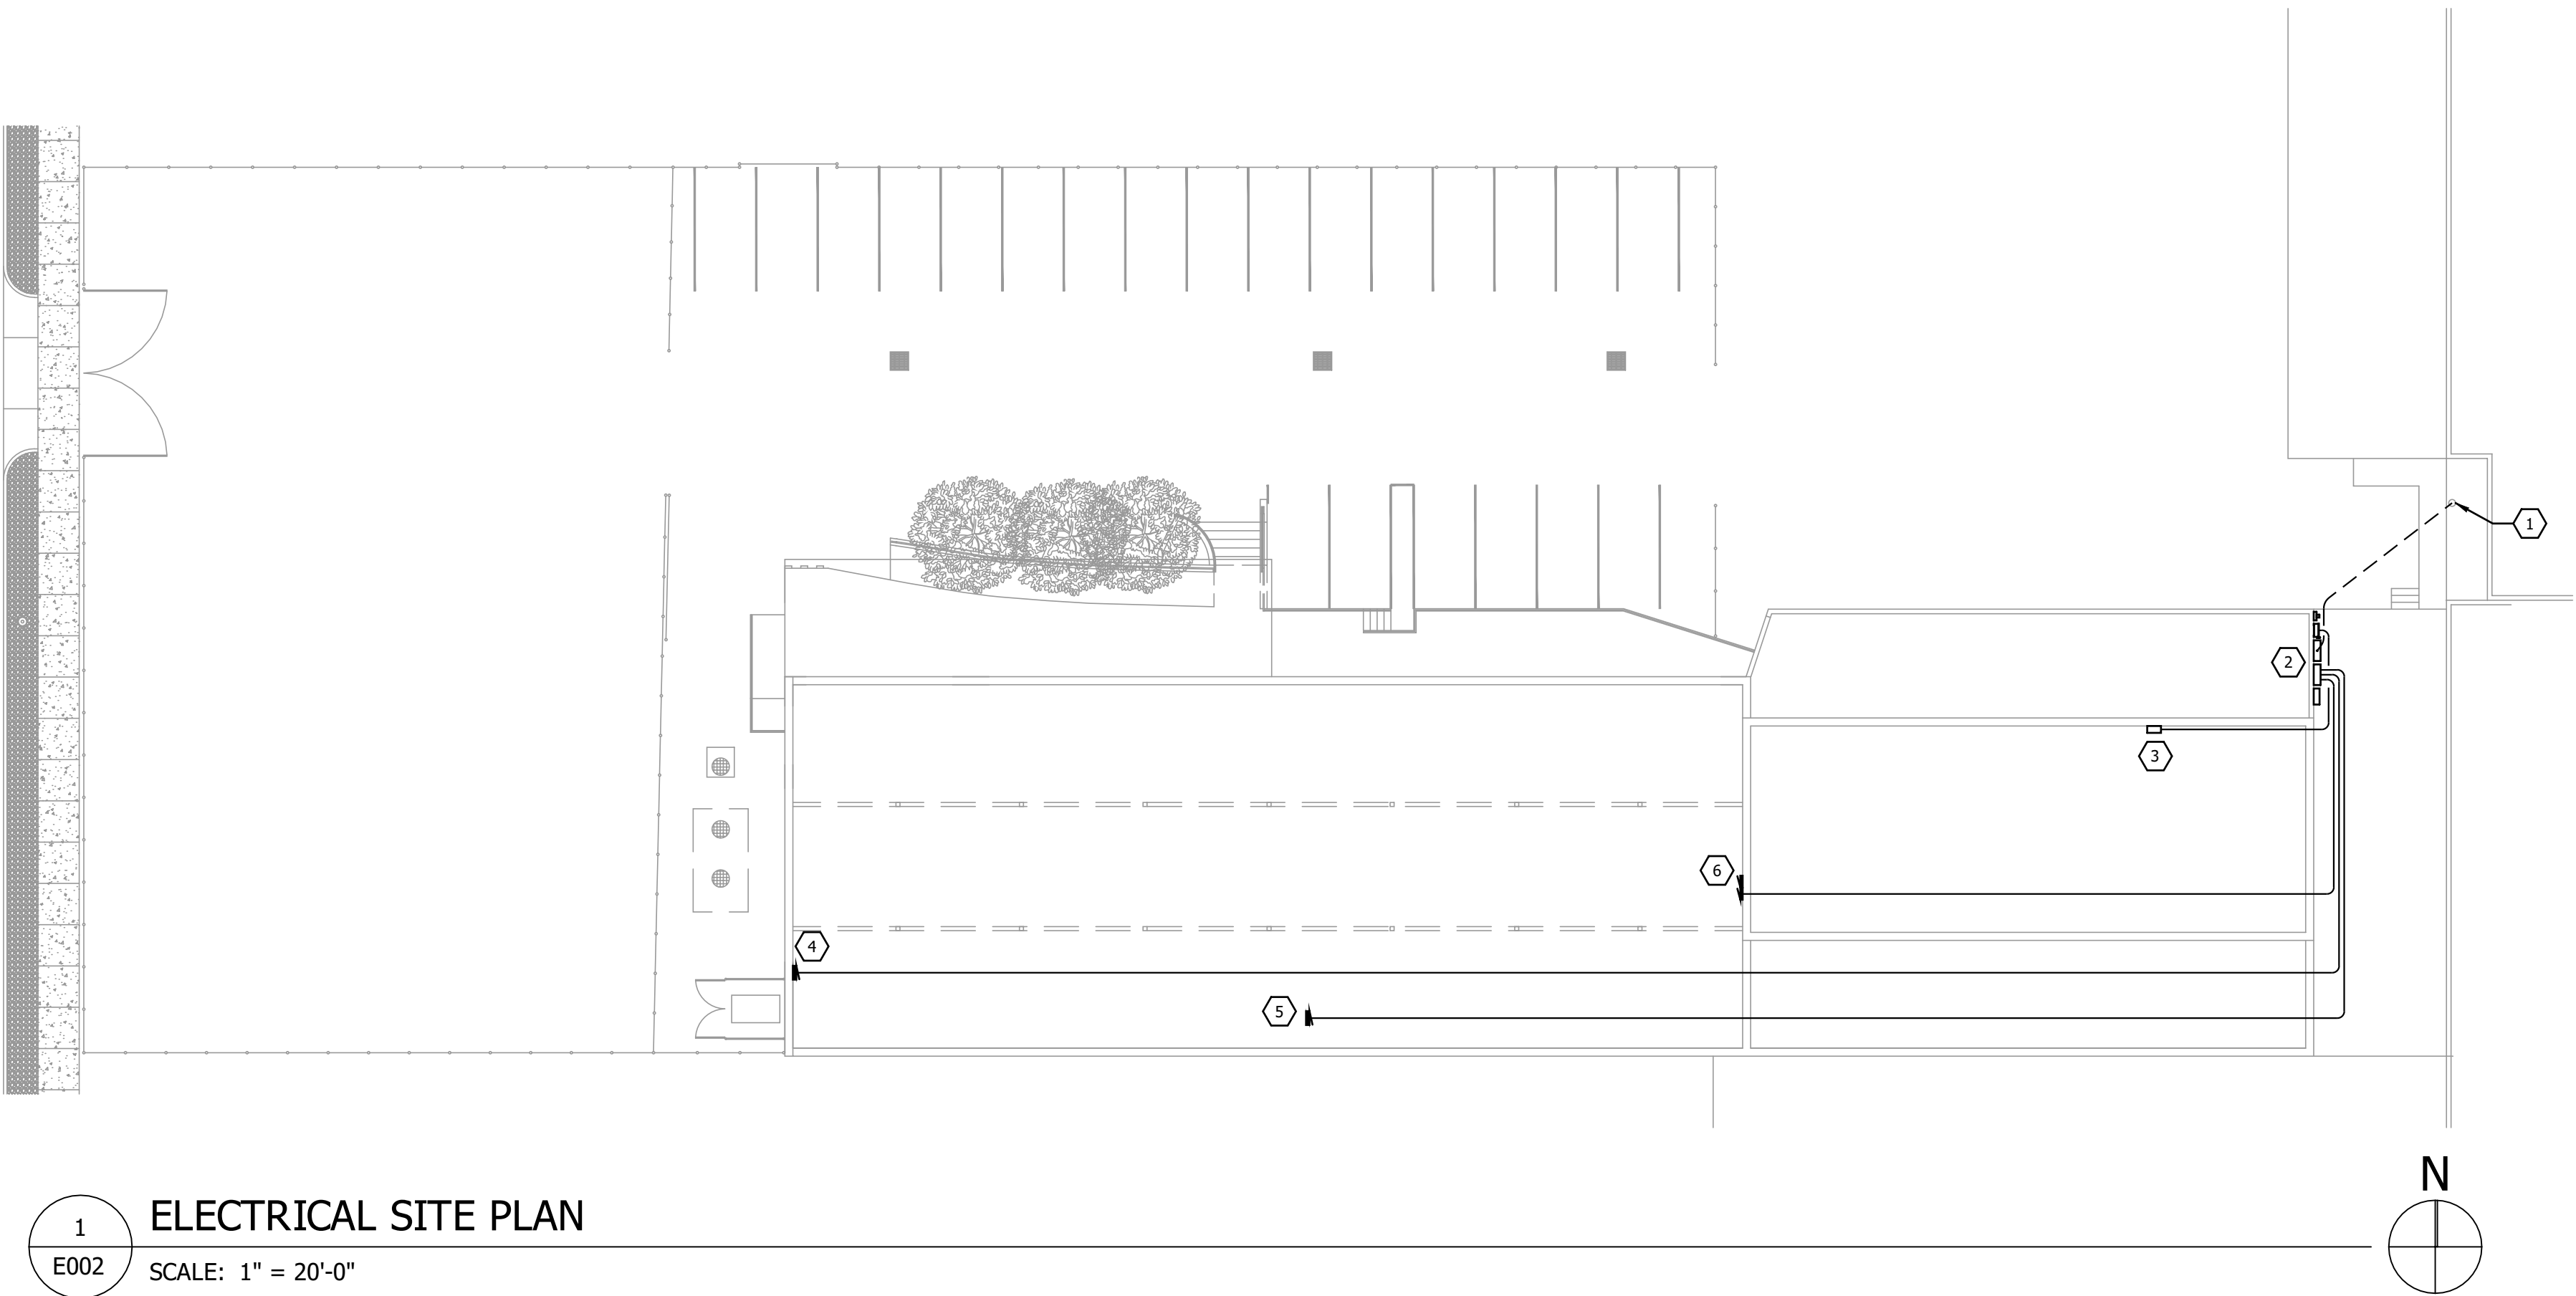

1
E002
ELECTRICAL SITE PLAN
SCALE: 1" = 20'-0"

#

KEYED NOTES


1. EXISTING UTILITY POLE WITH NEW POLE MOUNTED TRANSFORMERS. COORDINATE WITH RMP, CONTACT JENNIFER BLUM AT (801)220-7207, FOR NEW ELECTRICAL SERVICE REQUIREMENTS. IDE PLACARDS AT BOTH SERVICE POINTS ON THE BUILDING TO IDENTIFY SERVICE LOCATIONS. CONTRACTOR TO EXTEND PRIMARY CONDUIT FROM THIS LOCATION UNDERGROUND TO THE NEW SERVICE EQUIPMENT MOUNTED ON THE SIDE OF THE BUILDING. SAWCUT ASPHALT/CONCRETE AS NECESSARY. PATCH/REPAIR TO MATCH EXISTING. COORDINATE WITH LANDLORD AND RMP.
2. EXTERIOR LOCATION FOR CT ENCLOSURE, SERVICE DISCONNECTS AND METERS. COORDINATE WITH EXTERIOR WINDOWS AND OTHER OBSTRUCTIONS PRIOR TO INSTALLATION.
3. EXISTING LANDLORD ELECTRICAL DISTRIBUTION. CONNECT NEW 200A, 120/208V, 3Ø FEEDER TO EXISTING FUSED DISCONNECT AND CHANGE FUSING TO 200A.
4. NEW PANEL P1, 200A, 120/208V, 3Ø. REFER TO ONE LINE DIAGRAM FOR MORE INFORMATION.
5. NEW PANEL P2, 200A, 120/208V, 3Ø. REFER TO ONE LINE DIAGRAM FOR MORE INFORMATION.
6. EXISTING LOAD CENTERS IN KITCHEN TO BE DISCONNECTED FROM EXISTING BUILDING SERVICE AND RECONNECTED TO THE NEW PANEL PB.

GENERAL NOTES

- A. NEW SERVICE LATERAL CONDUITS SHALL BE BURIED TO A DEPTH OF 24"-36" AS PER RMP ELECTRICAL SERVICE REQUIREMENTS MANUAL.

BEWILDER BREWERY

445 SOUTH 400 WEST
SALT LAKE CITY, UT 84101

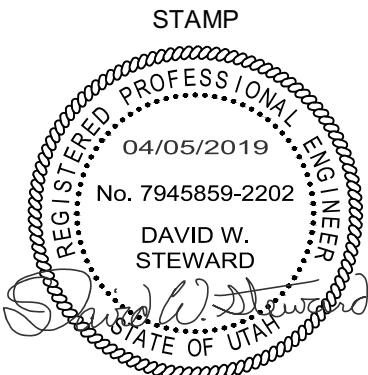

REVISIONS

| NO. | DESCRIPTION | DATE |
|-----|-------------|------|
| | | |
| | | |
| | | |
| | | |
| | | |

| | | |
|---|--|------------|
|  ROCKY MOUNTAIN CONSULTING ENGINEERS, INC. 2117 South 3600 West Salt Lake City, UT 84119 (801) 566-0503 www.rmceut.com | PROJECT #: | 18185 |
| | DRAWN BY: | DWS |
| | CHECKED BY: | DWS |
| | DATE: | 04/04/2019 |
| | (C) ROCKY MOUNTAIN CONSULTING ENGINEERS, INC. - 2019 | |

SHEET TITLE:

ELECTRICAL
SITE PLAN

E002