

BEAM SCHEDULE	
DESIGNATION	SIZE
RB1	(2) 2x10 DF-L #2
RB2	-
RB3	-
RB4	-
RB5	-
RB6	-
RB7	-
RB8	-
RB9	-
RB10	-
RB11	-
RB12	-

POST SCHEDULE	
DESIGNATION	SIZE
P1	ONE TRIMMER/STUD
P2	TWO TRIMMERS/STUDS
P3	THREE TRIMMERS/STUDS
P4	FOUR TRIMMERS/STUDS
P5	4x4 DF-L #2 POST
P6	6x6 DF-L #2 POST
P7	3 3/4"x5 1/2" PARALLAM
P8	5 1/2"x5 1/2" PARALLAM
P9	8x8 DF-L #2 POST
P10	10x10 DF-L #2 POST

- NOTES:
- SEE GENERAL STRUCTURAL NOTES SHEET (SN.1) FOR TYPICAL BEARING POST REQUIREMENTS.
 - POSTS INDICATE NUMBER OF TRIMMERS WHEN SPECIFIED AS HEADERS. ALL OTHER POST DESIGNATIONS REFER TO FULL HEIGHT KING STUDS.
 - INSTALL (2) TRIMMERS (MIN.) EACH SIDE OF HEADER GREATER THAN 6'-0" IN LENGTH (U.N.O.)
 - INSTALL (2) KING STUDS (MIN.) EACH SIDE OF HEADER ON OPENINGS GREATER THAN 8'-0" (U.N.O.)
 - INSTALL (2) KING STUDS (MIN.) AT ALL HOLDOWN LOCATIONS OR AS NOTED ON HOLDOWN SCHEDULE. (U.N.O.)

BEAM HANGER SCHEDULE		
DESIGNATION	DESCRIPTION	NOTES
RH1	HHUS26	-
RH2	-	-
RH3	-	-
RH4	-	-
RH5	-	-

ROOF SHEATHING SCHEDULE		
MATERIAL	8d NAILS SPACING	
	EDGE	FIELD
5/8" STRUCTURAL II PLYWOOD OR OSB	6"	12"


WALL FRAMING SCHEDULE	
ALL EXTERIOR BEARING WALLS TO BE 2x6 DF-L STUDS @ 24" O.C.	

TOP PLATE SPLICE SCHEDULE	
USE (XX) 16d NAILS ON TOP PLATE SPLICES - SEE DETAIL 3/ S.2	

- ROOF FRAMING PLAN NOTES
- DETAILS ARE NOTED ON THE PLANS IN TYPICAL LOCATIONS AND SHALL BE REPEATED WHERE SIMILAR CONDITIONS EXIST. SEE TYPICAL DETAILS AND GENERAL NOTES.
 - SEE STRUCTURAL DETAIL SHEETS (xx/s.x) FOR STRUCTURAL NOTES AND GENERAL USE DETAILS.
 - SEE DESIGN PLANS FOR DIMENSIONS. DO NOT SCALE STRUCTURAL DRAWINGS.
 - SEE TRUSS NOTES FOR ROOF TRUSSES LOADING AND SPECIFICATIONS. SEE ROOF SHEATHING NOTES FOR ROOF SHEATHING SIZE AND NAILING.
 - COORDINATE ALL TRUSS CONFIGURATIONS W/ DESIGN PLANS. SEE ROOF TRUSS NOTES.
 - ALL TRUSS HANGERS TO BE SPECIFIED BY TRUSS MANUFACTURER.

SHEAR WALL SCHEDULE:					
MARK	MATERIAL	8d NAILS SPACING		1 1/2" 16 GA. STAPLES	
		EDGE	FIELD	EDGE	FIELD
△	5/8" STRUCT. II PLYWOOD OR OSB	6"	6" (12")	4"	6"
△	5/8" STRUCT. II PLYWOOD OR OSB	4"	6" (12")	2 1/2"	6"
△	5/8" STRUCT. II PLYWOOD OR OSB	3"	6" (12")	N/A	N/A
△	5/8" STRUCT. II PLYWOOD OR OSB	2"	6" (12")	N/A	N/A

- NOTES:
- FIELD NAILING IS TO BE 12" O.C. WHEN STUD SPACING IS 16" O.C. OR LESS.
 - ALL SHEAR WALLS ARE BLOCKED AT ALL FREE EDGES WITH STUD FRAMING @ 24" O.C. (U.N.O.)
 - ALL ANCHOR BOLTS SHALL BE PER ASTM A307 AND HAVE 7" MIN. EMBEDMENT.
 - WHERE SHEAR WALL PANELS ARE APPLIED TO BOTH FACES OF A WALL, PANEL JOINTS SHALL BE OFFSET TO FALL ON DIFFERENT FRAMING MEMBERS.
 - FOR SHEAR WALLS △ AND △, ABUTTING PANEL EDGES ARE TO HAVE (2) 2X STUDS STITCHED TOGETHER W/ 16d SNIKERS @ 6" O.C.

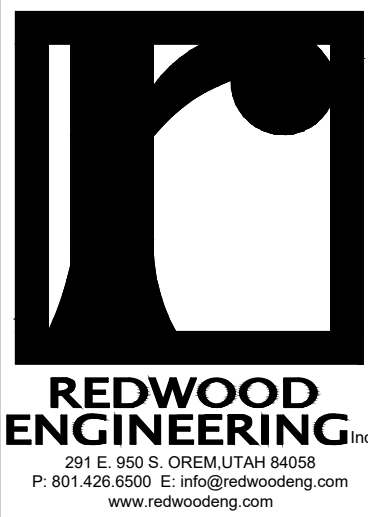

XX XX

ROOF FRAMING PLAN

DATE	REVISION

PROJECT NO: XX

DATE: DATE

SCALE: 3/16"=1'-0"

DRAWN BY: XX

CHECKED BY: XX

STAMP

SHEET NO.

F-3