

Steve Floor,



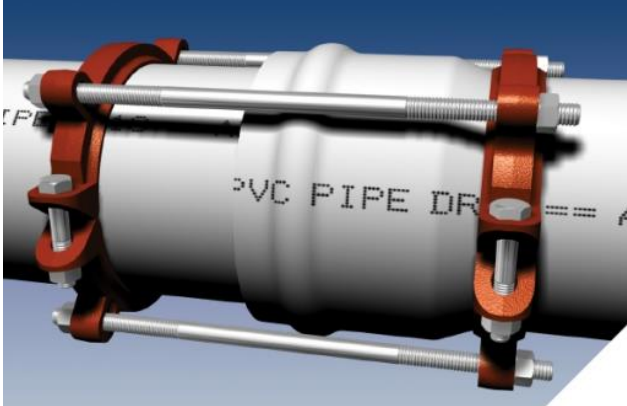
Underground is in the purview of Division 33 11 13.23 Plastic Public Water Utility Distribution Piping  
And: Division 33 11 19 Fire Suppression Utility Water Distribution Piping, and Div-31/33 Trench &  
Backfill to supply underground utility water to sprinkler riser.

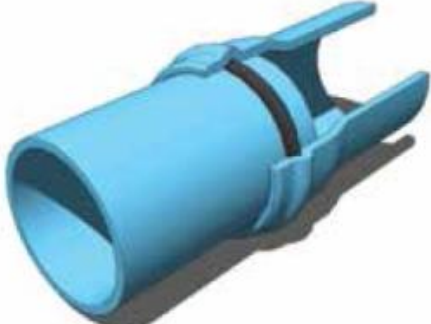
Not our area. We are Div-21

Suggested parts with corresponding pricing:

- Parts below are suggested as may be required.
- No design is implied
- No flow tests implied
- Sales tax not included

This document must in no way be interpreted as a design.

<p><b>Elbow</b> <b>Approx. two required @ \$55 ea</b></p>	
	<p><b>Wedge-Action Joint Restraint</b> <b>Approx. \$110 ea</b></p>
<p><b>Joint-Restraint</b> <b>Approx. 6 required at approx. \$399 ea</b></p>	

C900 Joint	
------------	--

<p>Break-away flange Two required @ approx. \$266 ea</p>	
	<p>Free Standing FDC Two <i>suggested</i> @ approx. 2,667.00 each.</p>
<p>C900 SDR 18 Pipe 4" \$375.00 per 20 ft length 8 to 9 lengths suggested.</p>	
<p>Allow for miscellaneous items 9%</p>	<p>Pipe-Cement, pipe-wrap, Concrete and Bollards etc.</p>
	