



**Fire Suppression Services Inc.**  
3802 S. 2300 E. Millcreek  
Utah 84109-3421  
(801) 277-6464

Owner Company inc  
OWNERS/TFEET  
OWNERCITY 84115  
OwnerName  
(801) 573-8045

Drawn by:  
Arun

Date drawn:  
2022-07-21

Date issued:  
2022-07-21

## Revisions

Δ	2022-mm-dd CONFIRM part#s
Δ	2022-mm-dd CONFIRM BREAKER Number & Loci
Δ	yyyy-mm-dd revThree
Δ	yyyy-mm-dd RevFour

**Project#**  
projNextAuto

**Owner** Owner Company inc

**Tenant** NextAuto

**Site** 50 W. Burton Ave.  
South Salt Lake City 84143  
sitePhone

**Drawing**

**FA-01**


1. Dedicated Function Alarm Panel to monitor ONLY the following:
  - 1.1. Smoke Detection
  - 1.2. Pull-Station.
  - 1.3. Contacts from paint mixing room Fire Suppression Contacts
2. There is no wet suppression sprinkler system/valve.
- and
3. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC
4. Power for ALL Fire Alarm panels, Fire Alarm Power Supplies (& Dialers where necessary), must be provided by a DEDICATED AC BRANCH CIRCUIT & CLEARLY labeled at the Fire Panel and the Electrical Panel!

### WARNING TO OCCUPANT:

**2022-06-13** This design is subject to the Proviso that **NO HAZARDOUS or FLAMMABLE MATERIALS** of any kind are permitted to be stored on-site.


**Recommend:** adding a Safety Storage Cabinet for paint/thinners.

Further Code Review and permitting will be required .

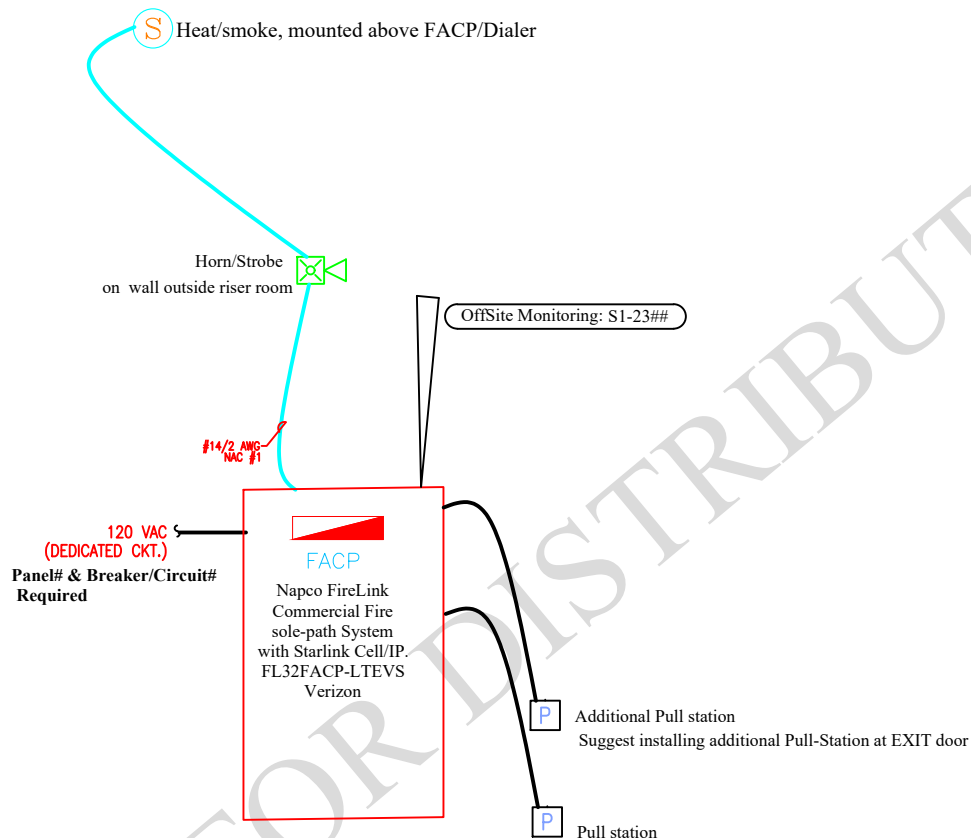

Fire Alarm Symbols/Legend				
Symbol	Description	#	Part Number	Mounting
	Fire Alarm Panel	1	FL-FACP-32-LTE-VS	Wall, @ 66"
	Smoke	1	SystemSensor 2-WB	Above FACP
	Pull station	2	SK-Pull DA	
	Horn strobe	1	SystemSensor P2R	Above door outside valve room
	Batteries	2	Duracell: SLA12-8A	inside FACP

For Professional Automotive Equipment Mike Rudert (801) 292-2224 xt 111



**Dedicated Function Fire Alarm @ OwnerName of tenanted space: NextAuto**

Dedicated Function Fire Alarm VIP Color Rev-05.dwg

A

B

C

D

E

F

G

H

I