




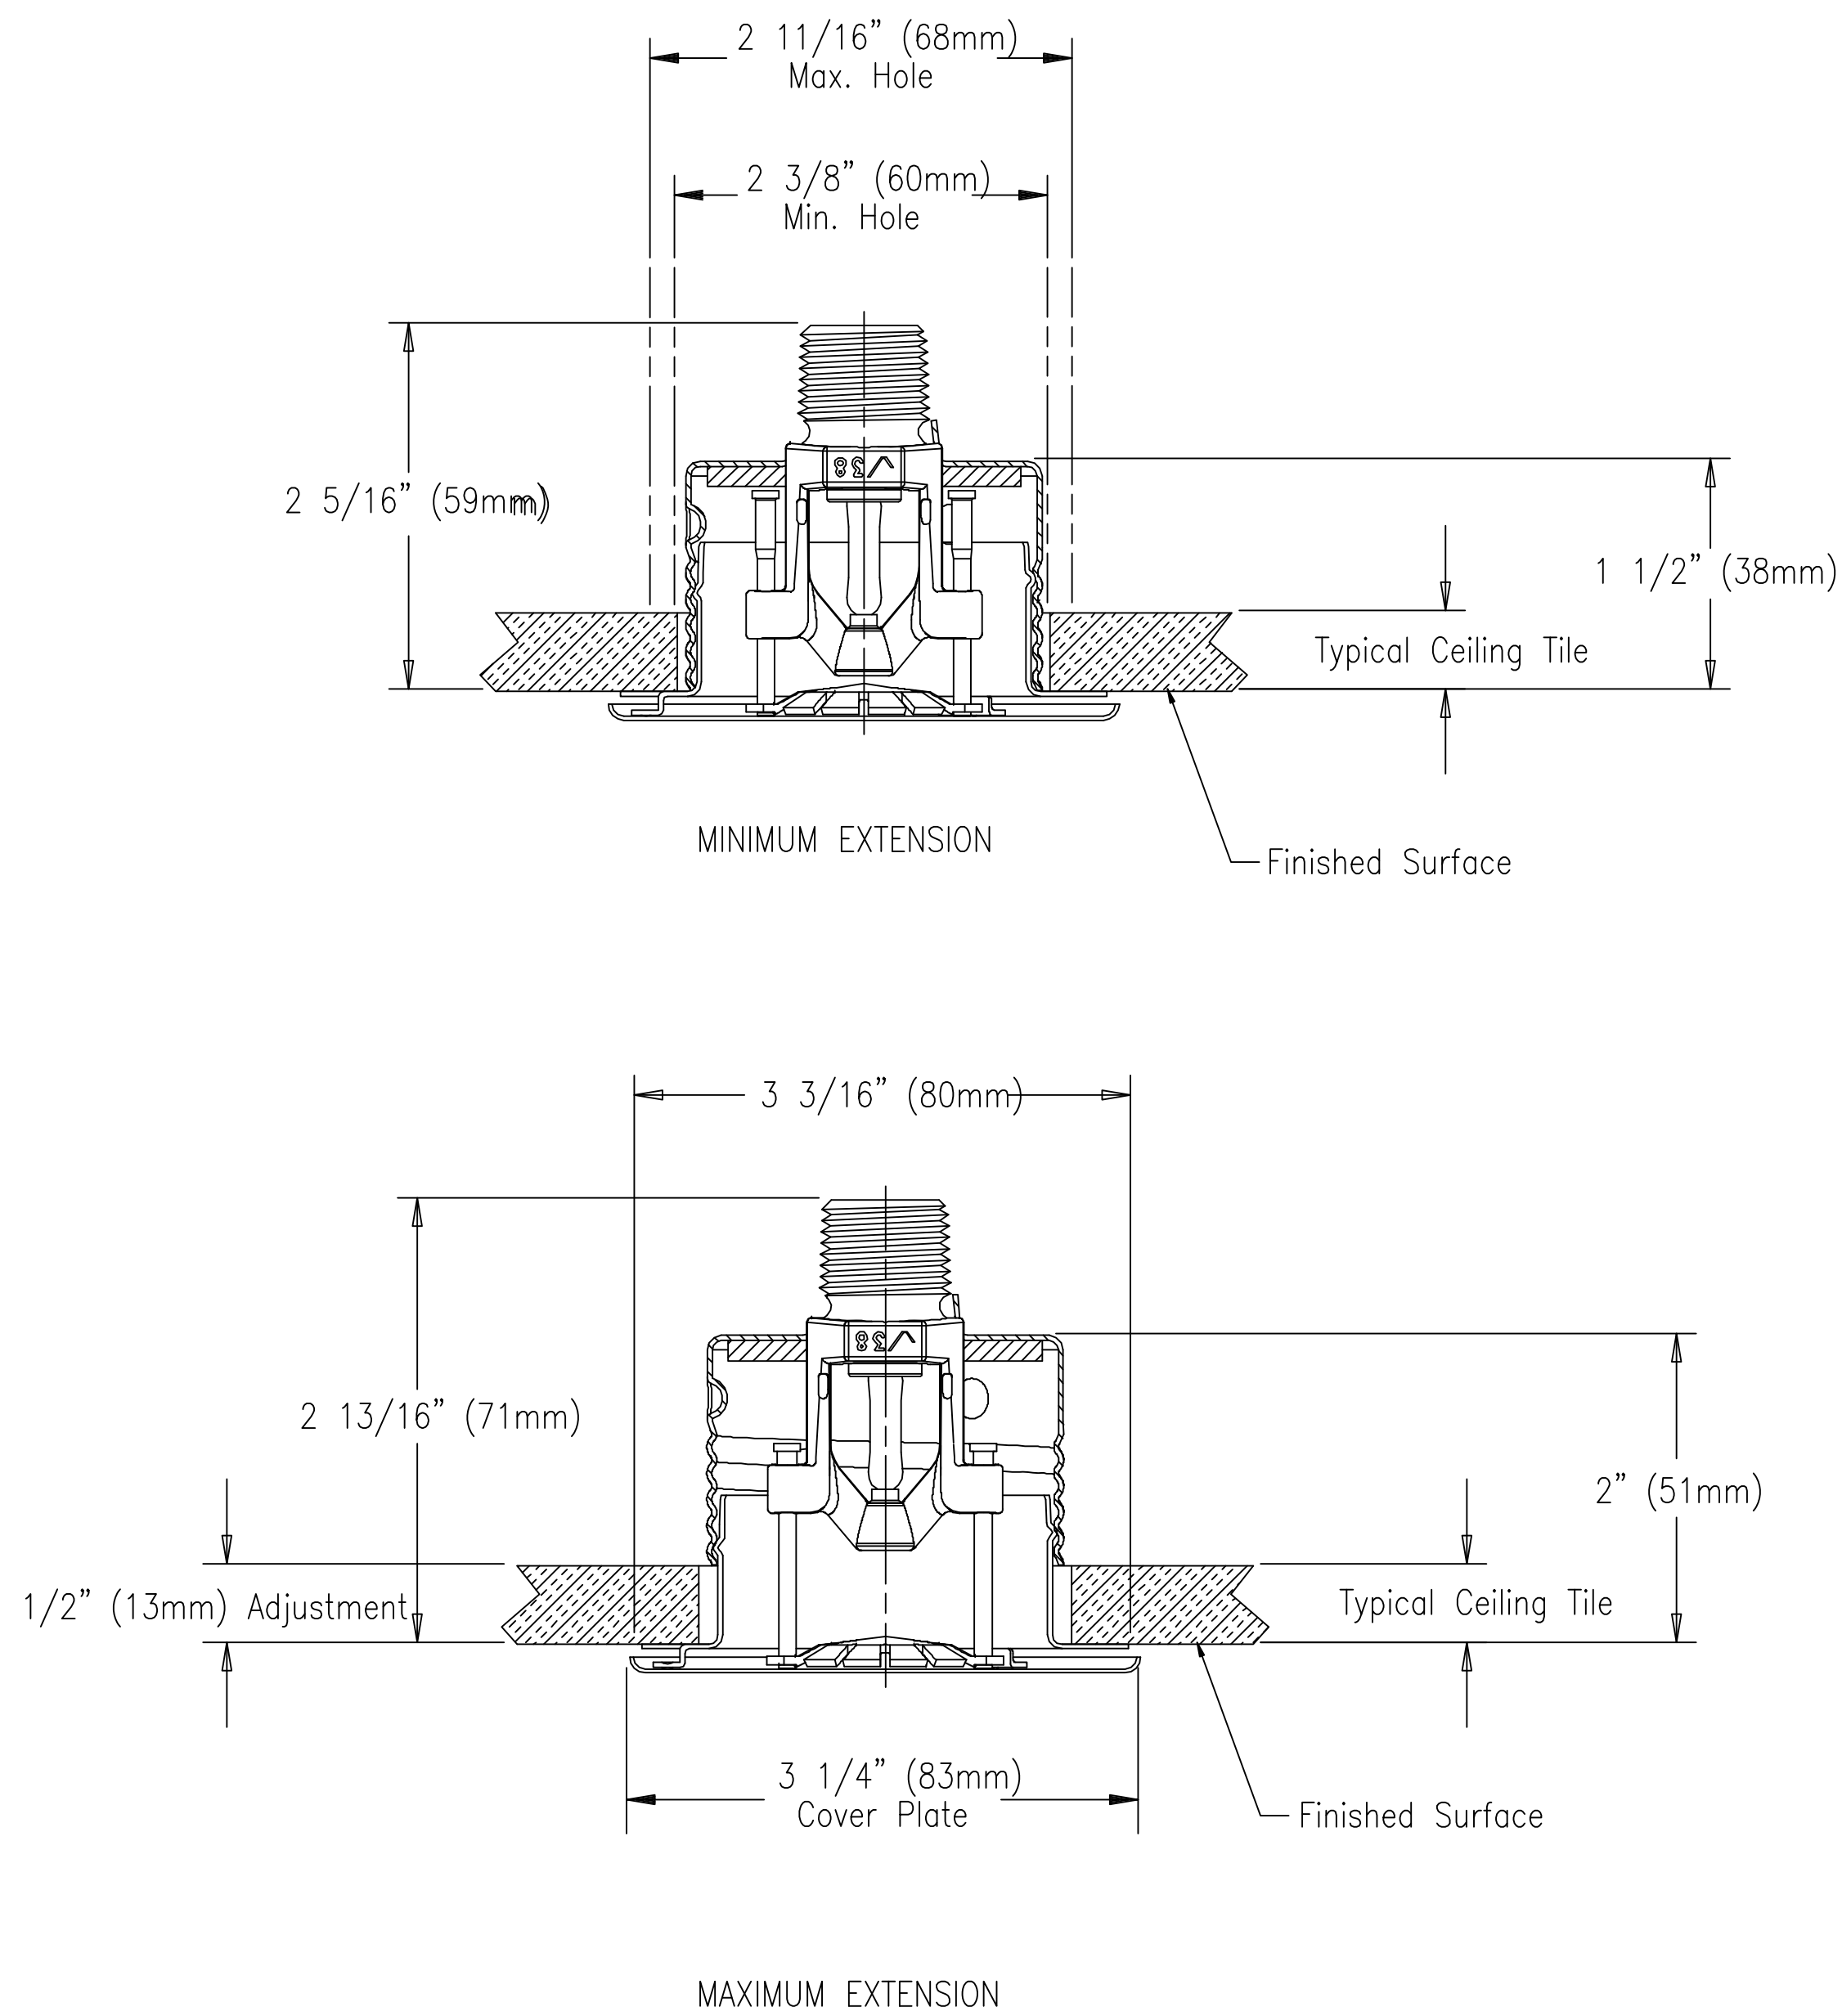

SUBMITTAL 40.50

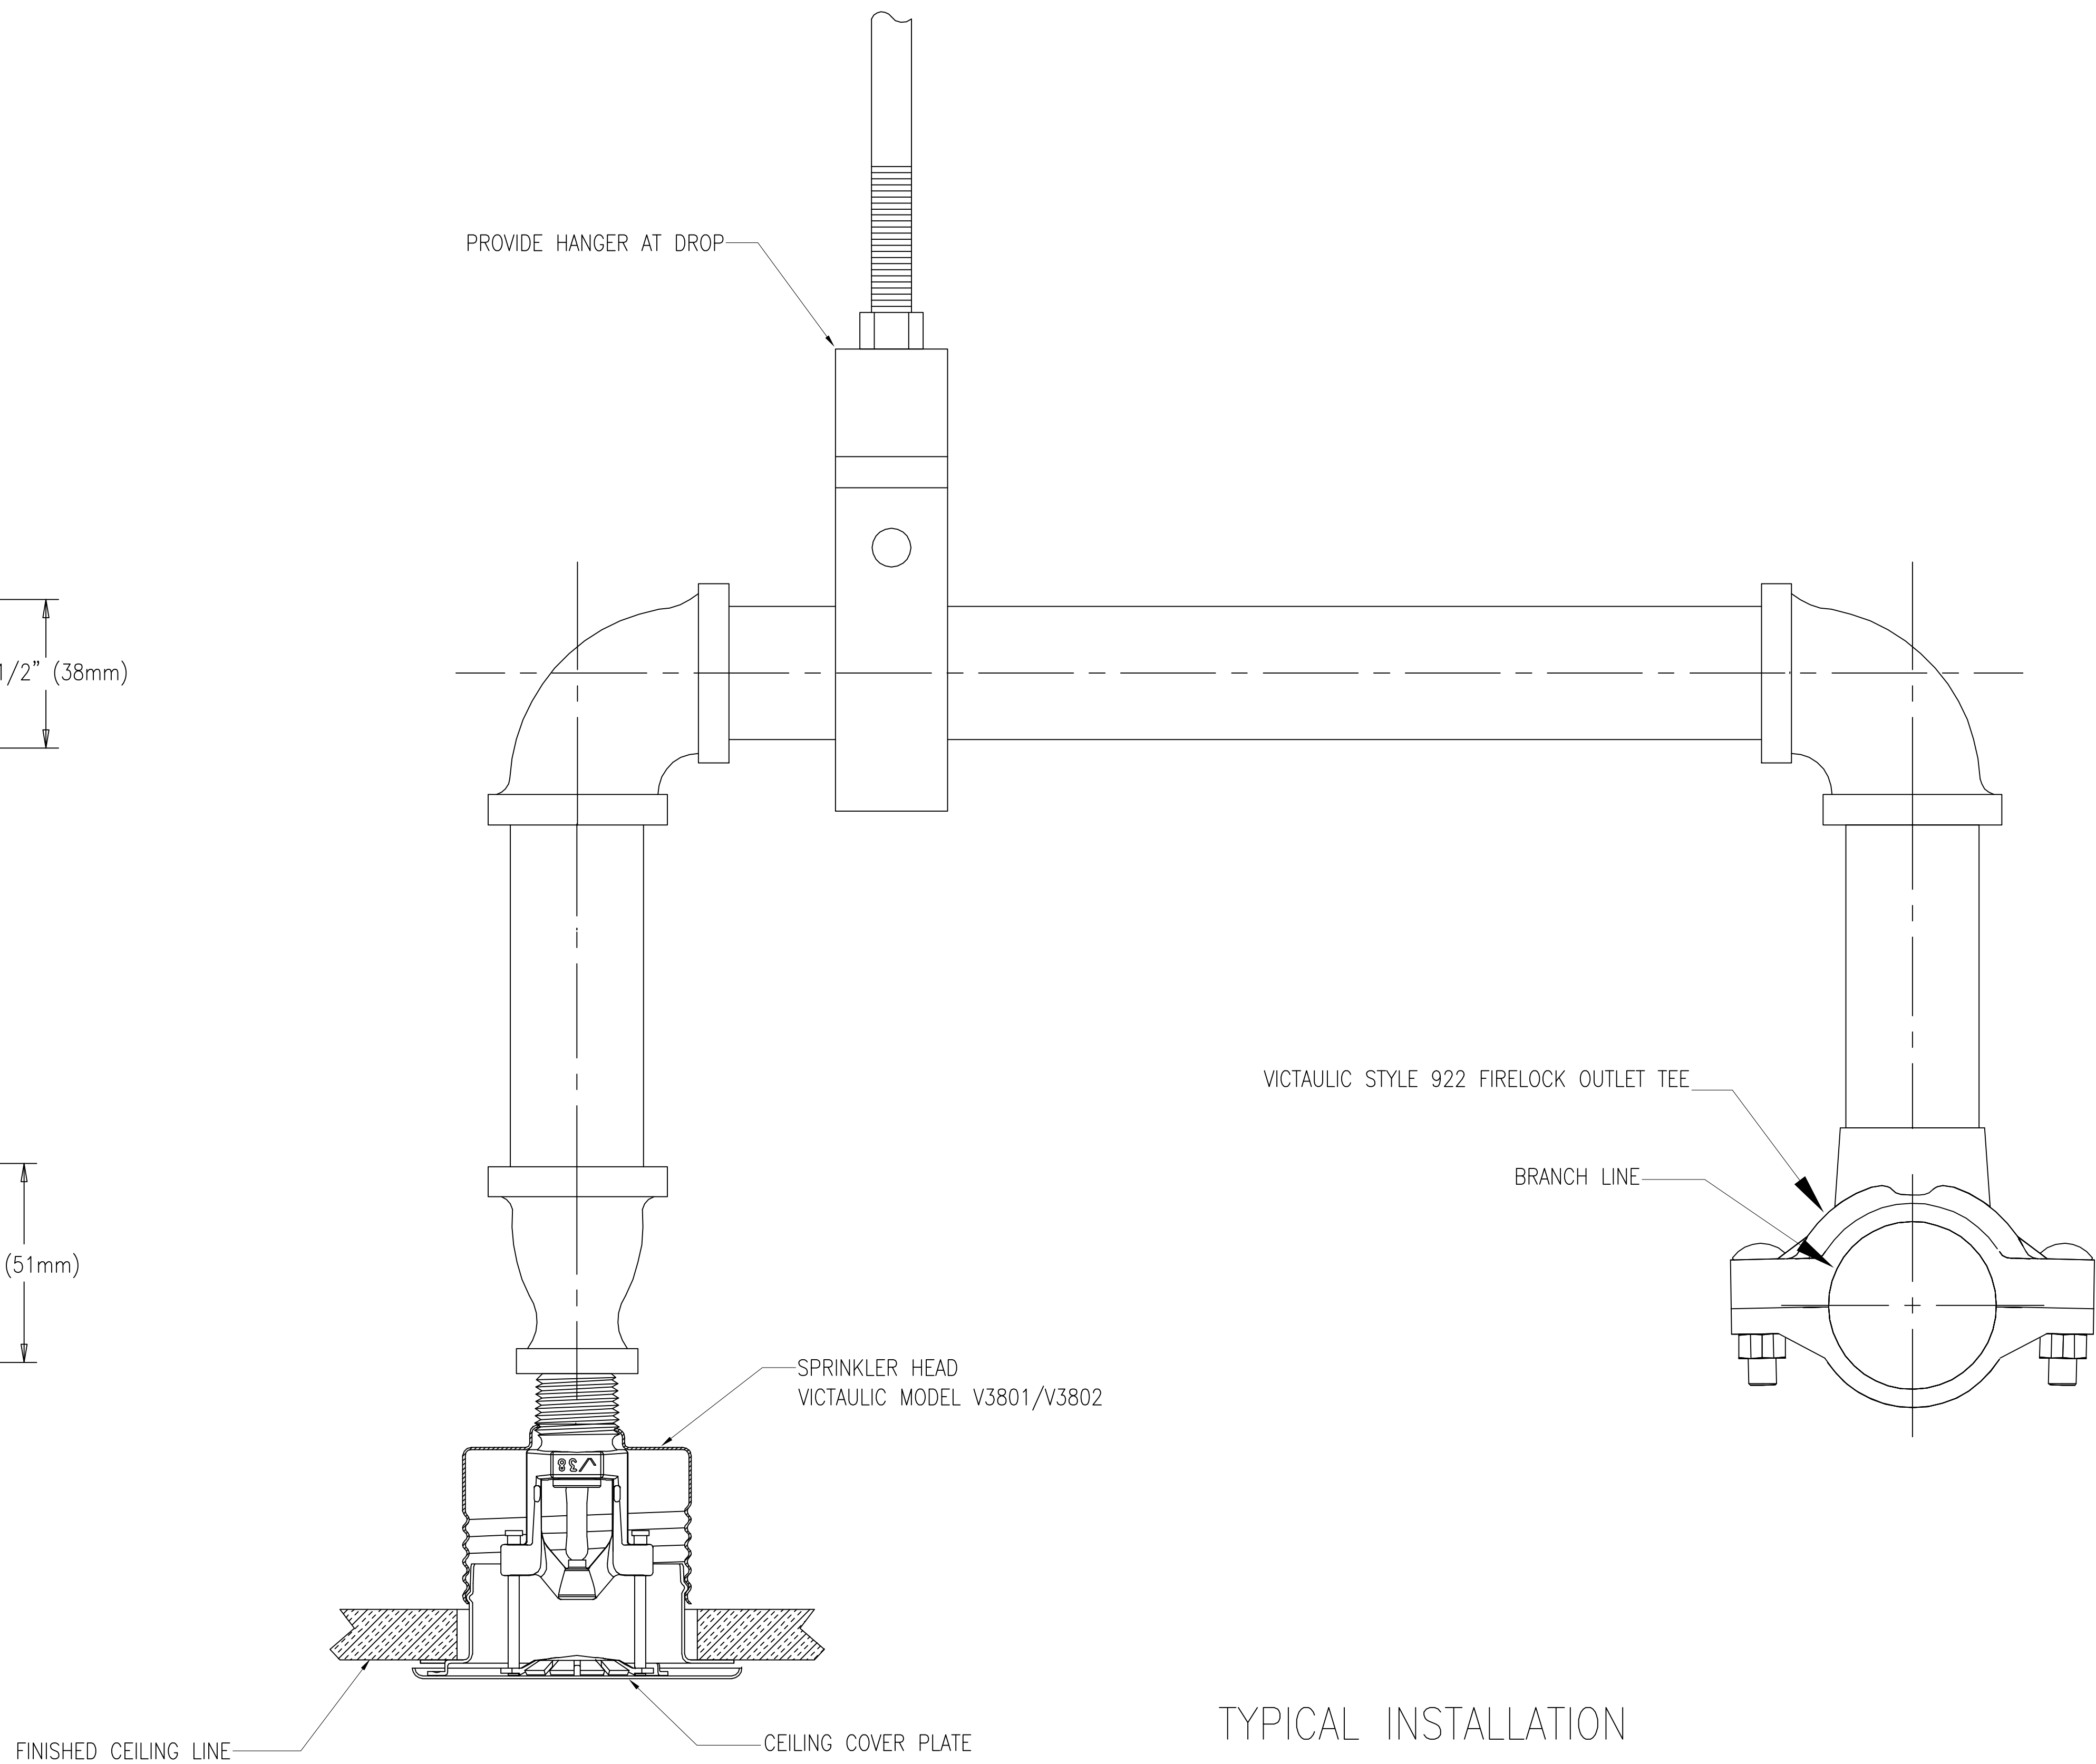

TYPICAL INSTALLATION

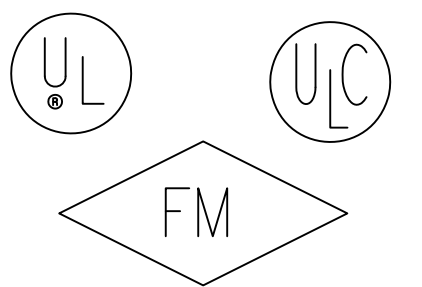

- NOTES:
1. REFER TO VICTAULIC SUBMITTAL 40.50 FOR ADDITIONAL INFORMATION.
 2. NYC MEA-275-99-E

ADJUSTABLE CONCEALED
STANDARD SPRAY PENDENT
STANDARD AND QUICK RESPONSE
VICTAULIC MODELS V3801 AND V3802

		CONSTRUCTION PIPING SERVICES DIVISION	
PROJECT: SPRK-V3801/V3802		PROJ.#	
CUSTOMER:		P.O.#	
SYSTEM: V3801/V3802 ADJUSTABLE CONCEALED PENDENT-CENTER OF TILE			
REF. DWG.: VICTAULIC SUBMITTAL 40.50 & SK042			
DRN.BY: RGS	DATE: 01/04/08	DRAWING NUMBER	REV.
CHK.BY: .	DATE: .	V3801/V3802	H